

\* 2015 Codes \*

## CHAPTER 7

# ONGROUND STORABLE RESIDENTIAL SWIMMING POOLS

### SECTION 701 GENERAL

**701.1 Scope.** This chapter describes certain criteria for the design, manufacturing, and testing of *onground storable pools* intended for *residential* use. This includes portable pools with flexible or nonrigid side walls that achieve their structural integrity by means of uniform shape, support frame or a combination thereof, and that can be disassembled for storage or relocation. This chapter includes what has been commonly referred to in past standards or codes as onground or above-ground pools.

**701.1.1 Permanent inground residential swimming pool.** This chapter does not apply to permanent inground *residential* pools, as defined in Chapter 8.

**701.2 General.** In addition to the requirements of this chapter, onground storable *residential* swimming pools shall comply with the requirements of Chapter 3.

**701.3 Floor slopes.** Floor slopes shall be uniform and in accordance with Sections 701.3.1 through 701.3.4.

**701.3.1 Shallow end.** The slope of the floor from the shallow end wall towards the deep area shall not exceed 1 unit vertical in 7 units horizontal (14-percent slope) to the point of the first slope change.

**701.3.2 Transition.** The slope of the floor from the point of the first slope change towards the deepest point shall not exceed 1 unit vertical in 3 units horizontal (33-percent slope).

**701.3.3 Adjacent.** The slope adjacent to the shallow area shall not exceed 1 unit vertical in 3 units horizontal (33-percent slope) and the slope adjacent to the side walls shall not exceed 1 unit vertical in 1 unit horizontal (100-percent slope).

**701.3.4 Change point.** The point of the first slope change shall be defined as the point at which the shallow area slope exceeds 1 unit vertical in 7 units horizontal (14-percent slope) and is not less than 6 feet (1889 mm) from the shallow end wall of the pool.

**701.4 Identification.** For onground storable *residential* pools with a vinyl liner, the manufacturer's name and the liner identification number shall be affixed to the liner. For onground storable *residential* pools without a liner, the manufacturer's name and identification number shall be affixed to the exterior of the pool structure.

**701.5 Installation.** *Onground storable pools* shall be installed in accordance with the manufacturer's instructions.

### SECTION 702 LADDERS AND STAIRS

**702.1 Ladders and stairs.** Pools shall have a means of entry and exit consisting of not less than one ladder or a ladder and staircase combination.

**702.2 Type A and Type B ladders.** Type A, double access, and Type B, limited access, A-frame ladders shall comply with Sections 702.2.1 through 702.2.7. See Figure 702.2.

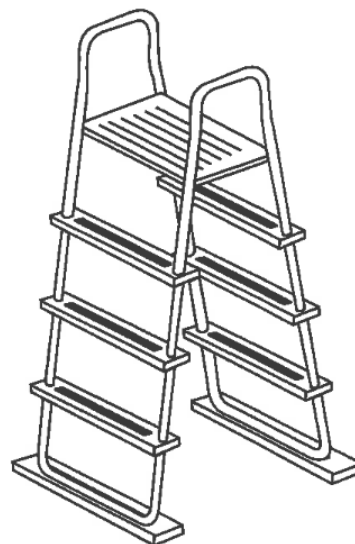


FIGURE 702.2  
TYPICAL A-FRAME LADDER, TYPES A AND B

**702.2.1 Barrier required.** Ladders in the pool shall have a physical barrier to prevent children from swimming through the riser openings or behind the ladder.

**Exception:** Barriers for ladders shall not be required where the ladder manufacturer provides a certification statement that the ladder complies with the ladder entrapment test requirements of APSP 4.

**702.2.2 Platform.** Where an A-frame ladder has a platform between the handrails, the platform shall have a width of not less than 12 inches (305 mm) and a length of not less than 12 inches (305 mm). The platform shall be at or above the highest ladder tread. The walking surface of the platform shall be slip resistant.

## ONGROUND STORABLE RESIDENTIAL SWIMMING POOLS

**702.2.3 Handrails or handholds.** A-frame ladders shall have two handrails or handholds that serve all treads. The height of the handrails and handholds shall be not less than 20 inches (508 mm) above the platform or uppermost tread, whichever is higher.

**702.2.4 Diameter.** The outside diameter of handrails and handholds shall be not less than 1 inch (25 mm) and not greater than 1.9 inches (48 mm).

**702.2.5 Clear distance.** The clear distance between ladder handrails shall be not less than a space of 12 inches (305 mm).

**702.2.6 Treads.** Ladder treads shall have a horizontal uniform depth of not less than 2 inches (51 mm).

**702.2.7 Riser height.** Risers, other than the bottom riser, shall be of uniform height that is not less than 7 inches (178 mm) and not greater than 12 inches (305 mm). The bottom riser height shall be not less than 7 inches (178 mm) and not greater than 12 inches (305 mm). The vertical distance from the platform or top of the pool structure to the uppermost tread shall be the same as the uniform riser heights.

**702.3 Type C staircase ladders (ground to deck).** Type C staircase ladders shall comply with Sections 702.3.1 through 702.3.6. See Figure 702.3.

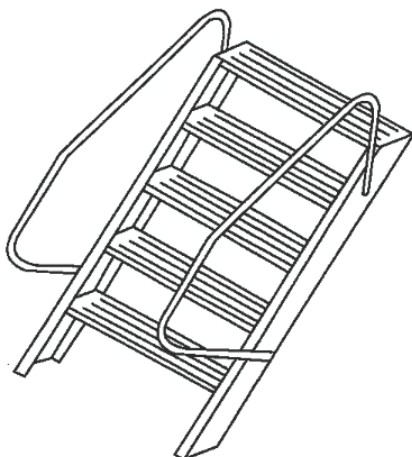


FIGURE 702.3  
TYPICAL STAIRCASE LADDER, TYPE C

**702.3.1 Handrails or handholds.** Staircase ladders shall have not less than two handrails or handholds that serve all treads. The height of the handrails and handholds shall be not less than 20 inches (508 mm) above the platform or uppermost tread, whichever is higher.

**702.3.2 Diameter.** The outside diameter of handrails and handholds shall be not less than 1 inch (25 mm) and not greater than 1.9 inches (48 mm).

**702.3.3 Treads.** Ladder treads shall have a horizontal uniform depth of not less than 4 inches (102 mm).

**702.3.4 Riser height.** Risers, other than the bottom riser, shall be of uniform height that is not less than 7 inches (178 mm) and not greater than 12 inches (305 mm). The bottom riser height shall be not less than 7 inches (178 mm) and not greater than 12 inches (305 mm). The vertical distance from the platform or top of the pool structure to the uppermost tread shall be the same as the uniform riser heights.

**702.3.5 Top step.** The top step of a staircase ladder shall be flush with the deck or 7 inches (178 mm) to 12 inches (305 mm) below the deck level.

**702.3.6 Width.** Steps shall have a minimum unobstructed width of 19 inches (483 mm) between the side rails.

**702.4 Type D in-pool ladders.** Type D in-pool ladders shall be in accordance with Sections 702.4.1 through 702.4.7. See Figure 702.4.

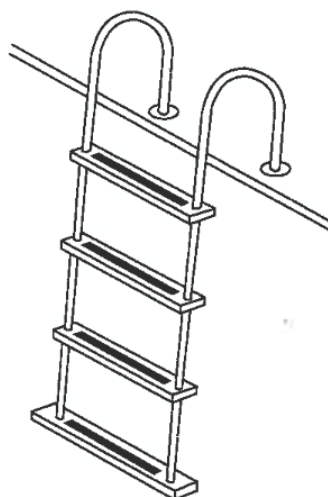


FIGURE 702.4  
TYPICAL IN-POOL LADDER, TYPE D

**702.4.1 Clearance.** There shall be a clearance of not less than 3 inches (76 mm) and not greater than 6 inches (152 mm) between the pool wall and the ladder.

**702.4.2 Handrails or handholds.** Ladders shall be equipped with two handrails or handholds that extend above the platform or deck not less than 20 inches (508 mm).

**702.4.3 Clear distance.** The clear distance between ladder handrails shall be not less than 12 inches (305 mm).

**702.4.4 Diameter.** The outside diameter of handrails and handholds shall be not less than 1 inch (25 mm) and not greater than 1.9 inches (48 mm).

**702.4.5 Riser height.** Risers, other than the bottom riser, shall be of uniform height that is not less than 7 inches (178 mm) and not greater than 12 inches (305 mm). The bottom riser height shall be not less than 7 inches (178 mm) and not greater than 12 inches (305 mm).

## ONGROUND STORABLE RESIDENTIAL SWIMMING POOLS

**702.4.6 Top tread.** The vertical distance from the pool coping, deck, or step surface to the uppermost tread shall be not less than 7 inches (178 mm) and not greater than 12 inches (305 mm) and uniform with other riser heights.

**702.4.7 Tread depth.** Ladder treads shall have a horizontal uniform depth of not less than 2 inches (51 mm).

**702.5 Type E protruding in-pool stairs.** Type E protruding in-pool stairs shall be in accordance with Sections 702.5.1 through 702.5.7. See Figure 702.5.

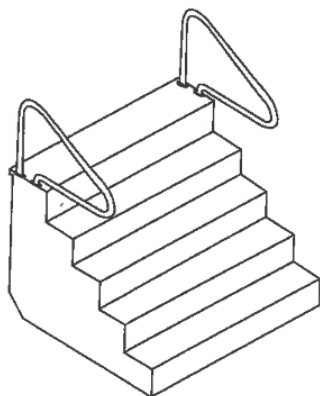


FIGURE 702.5  
TYPICAL IN-POOL STAIRCASE TYPES, E AND F

**702.5.1 Barrier required.** In-pool stairs shall have a physical barrier to prevent children from swimming through the riser openings or behind the in-pool stairs.

**702.5.2 Handrails or handholds.** In-pool stairs shall be equipped with not less than one handrail or handhold that serves all treads with a height of not less than 20 inches (508 mm) above the platform or uppermost tread, whichever is higher.

**702.5.3 Removable handrails.** Where handrails are removable, they shall be installed such that they cannot be removed without the use of tools.

**702.5.4 Leading edge distance.** The leading edge of handrails shall be 18 inches (457 mm)  $\pm$  3 inches ( $\pm$  76 mm), horizontally from the vertical plane of the bottom riser.

**702.5.5 Diameter.** The outside diameter of handrails and handholds shall be not less than 1 inch (25 mm) and not greater than 1.9 inches (48 mm).

**702.5.6 Tread width and depth.** Treads shall have an unobstructed horizontal depth of not less than 10 inches (254 mm) and an unobstructed surface area of not less than 240 square inches (0.15 m<sup>2</sup>).

**702.5.7 Uniform riser height.** Risers, other than the bottom riser, shall be of uniform height that is not less than 7 inches (178 mm) and not greater than 12 inches (305 mm). The bottom riser height shall be not less than 7 inches (178 mm) and not greater than 12 inches (305 mm). The vertical

distance from the pool coping, deck or step surface to the uppermost tread of the stairs shall be the same as the uniform riser heights.

**702.6 Type F recessed in-pool stairs.** Type F recessed in-pool stairs shall be in accordance with Sections 702.6.1 through 702.6.7. See Figure 702.5.

**702.6.1 Barrier required.** In-pool stairs shall have a physical barrier to prevent children from swimming through the riser openings or behind the in-pool stairs.

**702.6.2 Handrails or handholds.** In-pool stairs shall be equipped with not less than one handrail or handhold that serves all treads with a height of not less than 20 inches (508 mm) above the platform or uppermost tread, whichever is higher.

**702.6.3 Removable handrails.** Where handrails are removable, they shall be installed such that they cannot be removed without the use of tools.

**702.6.4 Leading edge distance.** The leading edge of handrails shall be 18 inches (457 mm)  $\pm$  3 inches ( $\pm$  76 mm), horizontally from the vertical plane of the bottom riser.

**702.6.5 Diameter.** The outside diameter of handrails and handholds shall be not less than 1 inch (25 mm) and not greater than 1.9 inches (48 mm).

**702.6.6 Tread width and depth.** Treads shall have an unobstructed horizontal depth of not less than 10 inches (254 mm) at all points and an unobstructed surface area of not less than 240 square inches (0.15 m<sup>2</sup>).

**702.6.7 Uniform riser height.** Risers, other than the bottom riser, shall be of uniform height that is not less than 7 inches (178 mm) and not greater than 12 inches (305 mm). The bottom riser height shall be not less than 7 inches (178 mm) and not greater than 12 inches (305 mm). The vertical distance from the pool coping, deck or step surface to the uppermost tread of the stairs shall be the same as the uniform riser heights.

## SECTION 703 DECKS


**703.1 General.** Decks provided by the pool manufacturer shall be installed in accordance with the manufacturer's instructions. Decks fabricated on-site shall be in accordance with the *International Residential Code*.

**703.2 Cantilevered.** The top surface of a cantilevered deck shall be not greater than 1 inch (25 mm) higher than the top of the pool wall. See Figure 703.4. The top surface of a noncantilevered deck shall be not higher than the top of the pool wall.

**703.3 No gaps.** Decks that are installed flush with the top rail of the pool shall have all gap openings between the deck and top rails closed-off or capped.

**703.4 Extension over pool.** Where a deck extends inside the top rail of the pool, it shall extend not more than 3 inches (76 mm) beyond the inside of the top rail of the pool in accordance with Figure 703.4 and shall have a smooth finish.

## ON-GROUND STORABLE RESIDENTIAL SWIMMING POOLS

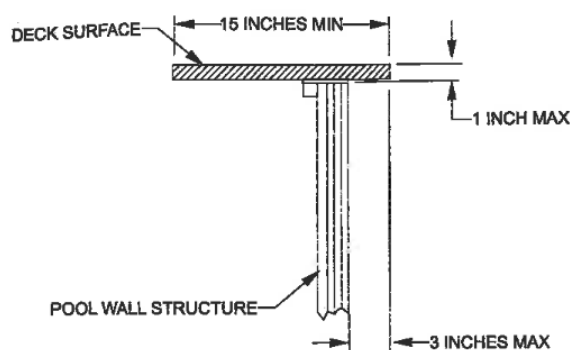


For SI: 1 inch = 25.4 mm.

FIGURE 703.4  
TYPICAL CANTILEVERED DECK SUPPORT

**703.5 Slip resistant.** The deck walking surface shall be slip resistant.

**703.6 Walk-around decks.** Walk-around decks shall have a level walking surface of not less than 15 inches (381 mm) in width, as measured from the inside edge of the pool top rail to the outside of the pool walk-around. See Figure 703.6.

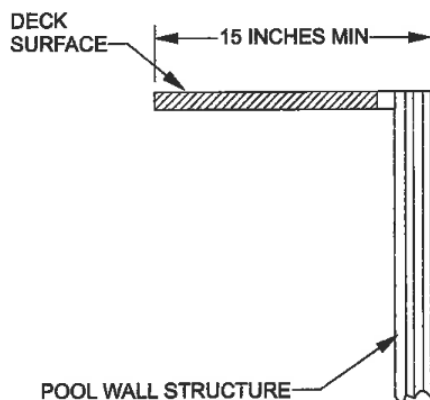

For SI: 1 inch = 25.4 mm.

FIGURE 703.6  
WALK-AROUND DECK WIDTH

### SECTION 704 CIRCULATION SYSTEM

**704.1 General.** A circulation system consisting of pumps, hoses, tubing, piping, return inlets, suction outlets, filters and other related equipment that provides for the circulation of water throughout the pool shall be located so that such items cannot be used by young children as a means of access to the pool.

**704.2 Installation and support.** Circulation equipment shall be installed, mounted and supported in accordance with the manufacturer's instructions.

**704.3 Draining the system.** In climates subject to freezing, circulation system equipment shall be designed and fabricated to drain the pool water from the equipment and exposed piping, by removal of drain plugs and manipulating valves or by other methods in accordance with the manufacturer's instructions.

**704.4 Turnover.** A pump including a motor shall be provided for circulation of the pool water. The equipment shall be sized to provide a turnover of the pool water not less than once every 12 hours. The system shall be designed to provide the required turnover rate based on the manufacturer's specified maximum flow rate of the filter, with a clean media condition of the filter. The system flow shall not exceed the filter manufacturer's maximum filter flow rate.

**704.5 Piping and fittings.** The process piping of the circulation system, including but not limited to hoses, tubing, piping, and fittings, shall be made of nontoxic material and shall be capable of withstanding an internal pressure of not less than  $1\frac{1}{2}$  times the rated pressure of the pump. Piping on the suction side of the pump shall not collapse when flow into such piping is blocked.

**704.6 Filters.** Pressure-type filters shall have an automatic internal means or a manual external means to relieve accumulated air pressure inside the filter tank. Filter tanks composed of upper and lower tank lids that are held in place by a perimeter clamp shall have a perimeter clamp that provides for a slow and safe release of air pressure before the clamp disengages the lids.

**704.6.1 Automatic internal air relief.** Filter tanks incorporating an automatic internal air relief as the principal means of air release shall be designed with a means to provide for a slow and safe release of pressure.

**704.6.2 Separation tank.** A separation tank used in conjunction with a filter tank shall have a manual air release or the tank shall be designed to provide for a slow and safe release of pressure when the tank is opened.

**704.7 Pumps.** Pool pumps shall be tested and certified by a nationally recognized testing laboratory in accordance with UL 1081.

**704.7.1 Cleanable strainer.** Where a pressure-type filter is installed, a cleanable strainer or screen that captures materials such as solids, debris, hair and lint shall be provided upstream of the circulation pump.

**704.7.2 Accessible pumps and motors.** Pumps and motors shall be accessible for inspection and service in accordance with the pump and motor manufacturer's instructions.

**704.7.3 Pump shutoff valves.** An accessible means of shut off of the suction and discharge piping for the pump shall be provided for maintenance and removal of the pump.

**704.8 Outlets and return inlets.** Outlets or suction outlets and return inlets shall be provided and arranged to produce



## ONGROUND STORABLE RESIDENTIAL SWIMMING POOLS

uniform circulation of water so that sanitizer residual is maintained throughout the pool. Where installed, submerged suction outlets shall conform to APSP 16.

**704.9 Surface skimmer systems.** The surface skimming system provided shall be designed and constructed to skim the pool surface when the water level is maintained between the minimum and maximum fill level of the pool.

**704.9.1 Coverage where used as a sole outlet.** Where surface skimmers are used as the only pool water outlet system, not less than one skimmer shall be provided for each 800 square feet (74.3 m<sup>2</sup>), or fraction thereof, of the water surface area.

**704.9.2 Coverage where used in combination with other outlets.** Where surface skimmers are not the only outlet for pool water, they shall be considered to cover only that fraction of the 800 square feet (74.3 m<sup>2</sup>).

**704.9.3 Location and venting.** Skimmers shall be equipped with a vent that serves as a vacuum break.

### SECTION 705 SAFETY SIGNS

**705.1. Signs to be installed prior to final inspection.** Safety signage such as "NO DIVING" signs and other safe use instruction signs that are provided by the pool and ladder manufacturer shall be posted in accordance with the manufacturer's instructions prior to final inspection.

**705.2 Safety signs for ladders.** Safety signage for ladders shall be in accordance with Sections 705.2.1 through 705.2.3.2.

**705.2.1 A-frame ladders.** Safety signage for A-frame ladders shall be in accordance with Sections 705.2.1.1 through 705.2.1.4.1. The words on the signage shall be readable by persons standing in the pool and standing outside of the pool as applicable for the required location of each sign.

**705.2.1.1 No diving warning.** A-frame ladders shall have the following words posted on the in-pool side of the ladder and on the pool entry side of the ladder: "NO DIVING." The location of the words shall be above the elevation of the design water level of the pool.

**705.2.1.2 Entrapment warning.** A-frame ladders shall have the following words posted on the pool side of the ladder: "TO PREVENT ENTRAPMENT OR DROWNING DO NOT SWIM THROUGH, BEHIND, OR AROUND LADDER."

**705.2.1.3 Type A, A-frame ladders.** Type A double access A-frame ladders shall have the following words posted on the ladder: "REMOVE AND SECURE LADDER WHEN POOL IS NOT OCCUPIED."

**705.2.1.4 Type B, A-frame ladders.** Type B limited access A-frame ladders shall have the following words posted on the ladder: "SECURE LADDER WHEN POOL IS NOT OCCUPIED."

**705.2.1.4.1 Swing up or slide up secured ladders.** Type B limited access A-frame ladders that utilize

swing-up or slide-up sections for limiting access to the pool shall have the following words posted on the ladder as applicable for the type of securing method:

1. "WHEN POOL IS NOT OCCUPIED, SWING UP AND SECURE."
2. "WHEN POOL IS NOT OCCUPIED, LIFT OFF."
3. "WHEN POOL IS NOT OCCUPIED, SLIDE UP AND SECURE."

**705.2.2 Type C staircase ladders.** Type C staircase ladders that swing up to limit access to the pool or that are removed to limit access to the pool shall have the following words posted on the ladder: "WHEN NOT IN USE SWING UP AND SECURE OR REMOVE."

**705.2.3 Type D in-pool ladder.** Safety signage for Type D in-pool ladders shall be in accordance with Sections 705.2.3.1 and 705.2.3.2. The words on the signage shall be readable by persons standing in the pool or standing outside the pool as applicable for the required location of each sign.

**705.2.3.1 No diving warning.** Type D in-pool ladders shall have the following words posted on the in-pool side of the ladder and on the pool entry side of the ladder: "NO DIVING." The location of the words shall be above the elevation of the design water level of the pool.

**705.2.3.2 Entrapment warning.** Type D in-pool ladders shall have the following words posted on the ladder: "WARNING: TO PREVENT ENTRAPMENT OR DROWNING, DO NOT SWIM THROUGH, BEHIND, OR AROUND LADDER."

\* 2015 Codes \*

## CHAPTER 8

## PERMANENT INGROUND RESIDENTIAL SWIMMING POOLS

SECTION 801  
GENERAL

**801.1 Scope.** The provisions of this chapter shall govern permanent inground *residential* swimming pools. Permanent inground *residential* swimming pools shall include pools that are partially or entirely above grade. This chapter does not cover pools that are specifically manufactured for above-ground use and that are capable of being disassembled and stored. This chapter covers new construction, modification and repair of inground *residential* swimming pools.

**801.2 General.** Permanent inground *residential* pools shall comply with the requirements of Chapter 3.

SECTION 802  
DESIGN

**802.1 Materials of components and accessories.** The materials of components and accessories used for permanent inground *residential* swimming pools shall be suitable for the environment in which they are installed. The materials shall be capable of fulfilling the design, installation and the intended use requirements in the *International Residential Code*.

**802.2 Structural design.** The structural design and materials shall be in accordance with the *International Residential Code*.

SECTION 803  
CONSTRUCTION TOLERANCES

**803.1 Construction tolerances.** The construction tolerance for dimensions for the overall length, width and depth of the pool shall be  $\pm 3$  inches (76 mm). The construction tolerance for all other dimensions shall be  $\pm 2$  inches (51 mm), unless otherwise specified by the design engineer.

SECTION 804  
DIVING WATER ENVELOPES

**804.1 General.** The minimum diving water envelopes shall be in accordance with Table 804.1 and Figure 804.1. Negative construction tolerances shall not be applied to the dimensions of the minimum diving water envelopes given in Table 804.1.

SECTION 805  
WALLS

**805.1 General.** Walls in the shallow area and deep area of the pool shall have a wall-to-floor transition point that is not less than 33 inches (838 mm) below the *design waterline*. Above the transition point, the walls shall be within 11 degrees (0.19 rad) of vertical.

SECTION 806  
OFFSET LEDGES

**806.1 Maximum width.** Offset ledges shall be not greater than 8 inches (203 mm) in width.

**806.2 Reduced width required.** Where an offset ledge is located less than 42 inches (1067 mm) below the *design waterline*, the width of such ledge shall be proportionately less than 8 inches (203 mm) in width so as to fall within 11 degrees of vertical as measured from the top of the *design waterline*.

SECTION 807  
POOL FLOORS

**807.1 Floor slopes.** Floor slopes shall be in accordance with Sections 807.1.1 through 807.1.3.

**807.1.1 Shallow end.** The slope of the floor from the beginning of the shallow end to the deep area floor slope transition point, indicated in Figure 804.1 as Point E to

TABLE 804.1  
MINIMUM DIVING WATER ENVELOPE FOR SWIMMING POOLS DESIGNATED TYPES I-V<sup>a</sup>

POOL TYPE	MINIMUM DEPTHS AT POINT FEET-INCHES				MINIMUM WIDTHS AT POINT FEET-INCHES				MINIMUM LENGTHS BETWEEN POINTS FEET-INCHES					
	A	B	C	D	A	B	C	D	WA	AB	BC	CD	DE	WE
I	6-0	7-6	5-0	2-9	10-0	12-0	10-0	8-0	1-6	7-0	7-6	Note a	6-0	28-9
II	6-0	7-6	5-0	2-9	12-0	15-0	12-0	8-0	1-6	7-0	7-6	Note a	6-0	28-9
III	6-10	8-0	5-0	2-9	12-0	15-0	12-0	8-0	2-0	7-6	9-0	Note a	6-0	31-3
IV	7-8	8-0	5-0	2-9	15-0	18-0	15-0	9-0	2-6	8-0	10-6	Note a	6-0	31-3
V	8-6	9-0	5-0	2-9	15-0	18-0	15-0	9-0	3-0	9-0	12-0	Note a	6-0	36-9

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm.

a. The minimum length between points C and D varies based on water depth at point D and the floor slope between points C and D.

b. See Figure 804.1 for location of points.


# PERMANENT INGROUND RESIDENTIAL SWIMMING POOLS

Point D, shall not exceed 1 unit vertical in 7 units horizontal.

**807.1.2 Shallow to deep transition.** The shallow to deep area floor slope transition point, indicated in Figure 804.1 as Point D, shall occur at a depth not less than 33 inches (838 mm) below the *design waterline* and at a point not less than 6 feet (1829 mm) from the beginning of the shallow end, indicated in Figure 804.1 as Point E, except as specified in Section 809.7.

**807.1.3 Deep end.** The slope of the floor in the deep end, indicated in Figure 804.1 as Point B to Point D, shall not exceed a slope of 1 unit vertical in 3 units horizontal (33-percent slope).

**807.2 Shallow end water depths.** The design water depth as measured at the shallowest point in the shallow area shall be not less than 33 inches (838 mm) and not greater than 4 feet (1219 mm). Shallow areas designed in accordance with Sections 809.6, 809.7 and 809.8 shall be exempt from the minimum depth requirement.

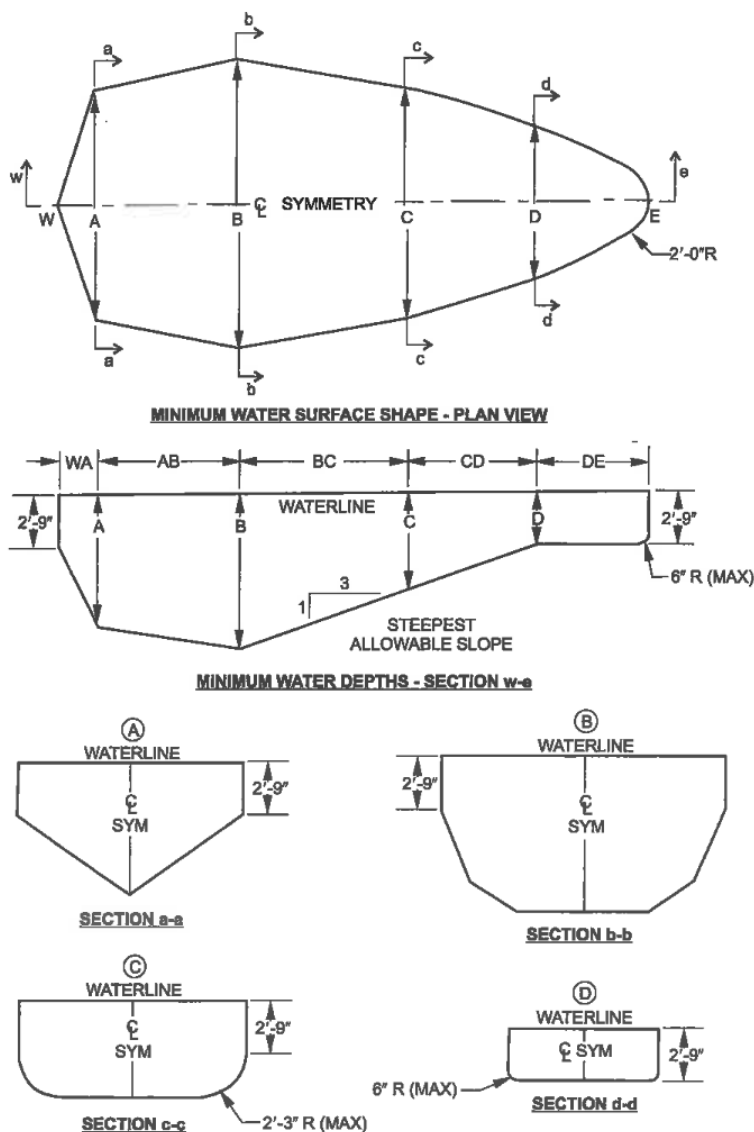

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm.

FIGURE 804.1  
MINIMUM DIVING WATER ENVELOPE

## PERMANENT INGROUND RESIDENTIAL SWIMMING POOLS

SECTION 808  
DIVING EQUIPMENT

**808.1 Manufactured and fabricated diving equipment.** Manufactured and fabricated diving equipment shall be in accordance with this section. Manufactured and fabricated diving equipment and appurtenances shall not be installed on a Type O pool.

**808.2 Manufactured diving equipment.** Manufactured diving equipment shall be designed for swimming pool use.

**808.3 Installation.** Where manufactured diving equipment is installed, the installation shall be located in the deep area of the pool so as to provide the minimum dimensions as shown in Table 804.1 and shall be installed in accordance with the manufacturer's instructions.

**808.4 Labeling.** Manufactured diving equipment shall have a permanently affixed label indicating the manufacturer's name and address, the date of manufacture, the minimum diving envelope and the maximum weight limitation.

**808.5 Slip resistant.** Diving equipment shall have slip-resistant walking surfaces.

**808.6 Point A.** For the application of Table 804.1, Point A shall be the point from which all dimensions of width, length and depth are established for the minimum diving water envelope. If the tip of the diving board or diving platform is located at a distance of WA or greater from the deep end wall and the water depth at that location is equal to or greater than the water depth requirement at Point A, then the point on the water surface directly below the center of the tip of the diving board or diving platform shall be identified as Point A.

**808.7 Location of pool features in a diving pool.** Where a pool is designed for use with diving equipment, the location of steps, pool stairs, ladders, underwater benches, special features and other accessory items shall be outside of the minimum diving water envelope as indicated in Figure 322.2.

**808.8 Stationary diving platforms and diving rocks.** Stationary diving platforms and diving rocks built on-site shall be permitted to be flush with the wall and shall be located in the diving area of the pool. Point A shall be in front of the wall at the platform or diving rock centerline.

**808.9 Location.** The forward tip of manufactured or fabricated diving equipment shall be located directly above Point A as defined by Section 808.6.

**808.10 Elevation.** The maximum elevation of a diving board above the *design waterline* shall be in accordance with the manufacturer's instructions.

**808.11 Minimum water envelope.** Manufactured diving equipment installation and use instructions shall be provided by the diving equipment manufacturer and shall specify the minimum water dimensions required for each diving board and diving stand combination. The board manufacturer shall indicate the water envelope type by dimensionally relating their products to Point A on the water envelopes as shown in Figure 804.1 and Table 804.1. The board manufacturer shall specify which boards fit on the design pool geometry types as indicated in Table 804.1.

**808.12 Platform height above waterline.** The height of a stationary diving platform or a diving rock above the *design waterline* shall not exceed the dimensions in Table 808.12.

TABLE 808.12  
DIVING PLATFORM OR APPURTENANCE  
HEIGHT ABOVE DESIGN WATERLINE

POOL TYPE	HEIGHT INCHES
I	42
II	42
III	50
IV	60
V	69

For SI: 1 inch = 25.4 mm.

**808.13 Headroom above the board.** The diving equipment manufacturer shall specify the minimum headroom required above the board tip.

SECTION 809  
SPECIAL FEATURES

**809.1 Slides.** Slides shall be installed in accordance with the manufacturer's instructions.

**809.2 Entry and exit.** Pools shall have a means of entry and exit in all shallow areas where the design water depth of the shallow area at the shallowest point exceeds 24 inches (610 mm). Entries and exits shall consist of one or a combination of the following: steps, stairs, ladders, treads, ramps, beach entries, underwater seats, benches, swimouts and other *approved* designs. The means of entry and exit shall be located on the shallow side of the first slope change.

**809.3 Secondary entries and exits.** Where water depth in the deep area of a pool exceeds 5 feet (1524 mm), a means of entry and exit shall be provided in the deep area of the pool.

**809.4 Over 30 feet in width.** Pools over 30 feet (9144 mm) in width at the deep area shall have an entry and exit on both sides of the deep area of the pool.

**809.5 Pool stairs.** The design and construction of stairs into the shallow end and recessed pool stairs shall conform to Sections 809.5.1 through 809.5.3.

**809.5.1 Tread dimension and area.** Treads shall have a minimum unobstructed horizontal depth of 10 inches (254 mm) and a minimum unobstructed surface area of 240 square inches (0.15 m<sup>2</sup>).

**809.5.2 Riser heights.** Risers, other than the top and bottom riser, shall have a uniform height of not greater than 12 inches (305 mm). The top riser height shall be any dimension not exceeding 12 inches (305 mm). The bottom riser height shall be any dimension not exceeding 12 inches (305 mm). The top and bottom riser heights shall not be required to be equal to each other or equal to the uniform riser height. Riser heights shall be measured at the horizontal centerline of the stairs.

**809.5.3 Additional steps.** In design water depths exceeding 48 inches (1219 mm), additional steps shall not be required.



**PERMANENT INGROUND RESIDENTIAL SWIMMING POOLS**

**809.6 Beach and sloping entries.** The slope of beach and sloping entries used as a pool entrance shall not exceed 1 unit vertical in 7 units horizontal (14-percent slope).

**809.7 Steps and sloping entries.** Where steps and benches are used in conjunction with sloping entries, the vertical riser distance shall not exceed 12 inches (305 mm). For steps used in conjunction with sloping entries, the requirements of Section 809.6 shall apply.

**809.8 Architectural features.** Surfaces of architectural features shall not be required to comply with the 1 unit vertical in 7 units horizontal (14-percent slope) slope limitation.

**809.9 Maximum depth.** The horizontal surface of underwater seats, benches and swimouts shall be not greater than 20 inches (508 mm) below the design waterline.

**SECTION 810  
CIRCULATION SYSTEMS**

**810.1 Turnover rate.** The circulation system equipment shall be sized to provide a turnover of the pool water not less than once every 12 hours. The system shall be designed to provide the required turnover rate based on the manufacturer's specified maximum flow rate of the filter, with a clean media condition of the filter.

➡ **810.2 Strainer required.** Pressure filter systems shall be provided with a strainer located between the pool and the circulation pump.

**SECTION 811  
SAFETY FEATURES**

**811.1 Rope and float.** In pools where the point of first slope break occurs, a rope and float assembly shall be installed across the width of the pool. The rope assembly shall be located not less than 1 foot (305 mm) and not greater than 2 feet (610 mm) towards the shallow side of the slope break. Rope anchoring devices shall be permanently attached to the pool wall, coping or deck. Rope ends shall attach to the rope anchor devices so that the rope ends can be disconnected from the rope anchor device.

## GENERAL COMPLIANCE

permanent *residential* spas shall be controlled in accordance with the requirements of APSP 15.

### SECTION 304 FLOOD HAZARD AREAS

**304.1 General.** The provisions of Section 304 shall control the design and construction of pools and spas installed in *flood hazard areas*.

**[BS] 304.2 Determination of impacts based on location.** Pools and spas located in *flood hazard areas* indicated within the *International Building Code* or the *International Residential Code* shall comply with Section 304.2.1 or 304.2.2.

**Exception:** Pools and spas located in riverine *flood hazard areas* that are outside of designated floodways and pools and spas located in *flood hazard areas* where the source of flooding is tides, storm surges or coastal storms.

**[BS] 304.2.1 Pools and spas located in designated floodways.** Where pools and spas are located in designated floodways, documentation shall be submitted to the code official that demonstrates that the construction of the pools and spas will not increase the design flood elevation at any point within the jurisdiction.

**[BS] 304.2.2 Pools and spas located where floodways have not been designated.** Where pools and spas are located where design flood elevations are specified but floodways have not been designated, the applicant shall provide a floodway analysis that demonstrates that the proposed pool or spa and any associated grading and filling, will not increase the design flood elevation more than 1 foot (305 mm) at any point within the jurisdiction.

**[BS] 304.3 Pools and spas in coastal high-hazard areas.** Pools and spas installed in coastal high-hazard areas shall be designed and constructed in accordance with ASCE 24.

**[BS] 304.4 Protection of equipment.** Equipment shall be elevated to or above the design flood elevation or be anchored to prevent flotation and protected to prevent water from entering or accumulating within the components during conditions of flooding.

**304.5 GFCI protection.** Electrical equipment installed below the design flood elevation shall be supplied by branch circuits that have ground-fault circuit interrupter protection for personnel.

### SECTION 305 BARRIER REQUIREMENTS

**305.1 General.** The provisions of this section shall apply to the design of barriers for pools and spas. These design controls are intended to provide protection against the potential drowning and near drowning by restricting access to such pools or spas. These requirements provide an integrated level of protection against potential drowning through the use of physical barriers and warning devices.

#### Exceptions:

1. Spas and hot tubs with a lockable *safety cover* that complies with ASTM F 1346.

2. Swimming pools with a powered *safety cover* that complies with ASTM F 1346.

**305.2 Outdoor swimming pools and spas.** Outdoor pools and spas and indoor swimming pools shall be surrounded by a barrier that complies with Sections 305.2.1 through 305.7.

**305.2.1 Barrier height and clearances.** Barrier heights and clearances shall be in accordance with all of the following:

1. The top of the barrier shall be not less than 48 inches (1219 mm) above grade where measured on the side of the barrier that faces away from the pool or spa. Such height shall exist around the entire perimeter of the barrier and for a distance of 3 feet (914 mm) measured horizontally from the outside of the required barrier.
2. The vertical clearance between grade and the bottom of the barrier shall not exceed 2 inches (51 mm) for grade surfaces that are not solid, such as grass or gravel, where measured on the side of the barrier that faces away from the pool or spa.
3. The vertical clearance between a surface below the barrier to a solid surface, such as concrete, and the bottom of the required barrier shall not exceed 4 inches (102 mm) where measured on the side of the required barrier that faces away from the pool or spa.
4. Where the top of the pool or spa structure is above grade, the barrier shall be installed on grade or shall be mounted on top of the pool or spa structure. Where the barrier is mounted on the top of the pool or spa, the vertical clearance between the top of the pool or spa and the bottom of the barrier shall not exceed 4 inches (102 mm).

**305.2.2 Openings.** Openings in the barrier shall not allow passage of a 4-inch-diameter (102 mm) sphere.

**305.2.3 Solid barrier surfaces.** Solid barriers that do not have openings shall not contain indentations or protrusions that form handholds and footholds, except for normal construction tolerances and tooled masonry joints.

**305.2.4 Mesh fence as a barrier.** Mesh fences, other than chain link fences in accordance with Section 305.2.7, shall be installed in accordance with the manufacturer's instructions and shall comply with the following:

1. The bottom of the mesh fence shall be not more than 1 inch (25 mm) above the deck or installed surface or grade.
2. The maximum vertical clearance from the bottom of the mesh fence and the solid surface shall not permit the fence to be lifted more than 4 inches (102 mm) from grade or decking.
3. The fence shall be designed and constructed so that it does not allow passage of a 4-inch (102 mm) sphere under any mesh panel. The maximum vertical clearance from the bottom of the mesh fence and the solid surface shall not be more than 4 inches (102 mm) from grade or decking.

## GENERAL COMPLIANCE

4. An attachment device shall attach each barrier section at a height not lower than 45 inches (1143 mm) above grade. Common attachment devices include, but are not limited to, devices that provide the security equal to or greater than that of a hook-and-eye-type latch incorporating a spring-actuated retaining lever such as a safety gate hook.
5. Where a hinged gate is used with a mesh fence, the gate shall comply with Section 305.3.
6. Patio deck sleeves such as vertical post receptacles that are placed inside the patio surface shall be of a nonconductive material.
7. Mesh fences shall not be installed on top of onground *residential* pools.

**305.2.5 Closely spaced horizontal members.** Where the barrier is composed of horizontal and vertical members and the distance between the tops of the horizontal members is less than 45 inches (1143 mm), the horizontal members shall be located on the pool or spa side of the fence. Spacing between vertical members shall not exceed  $1\frac{3}{4}$  inches (44 mm) in width. Where there are decorative cutouts within vertical members, spacing within the cutouts shall not exceed  $1\frac{3}{4}$  inches (44 mm) in width.

**305.2.6 Widely spaced horizontal members.** Where the barrier is composed of horizontal and vertical members and the distance between the tops of the horizontal members is 45 inches (1143 mm) or more, spacing between vertical members shall not exceed 4 inches (102 mm). Where there are decorative cutouts within vertical members, the interior width of the cutouts shall not exceed  $1\frac{3}{4}$  inches (44 mm).

**305.2.7 Chain link dimensions.** The maximum opening formed by a chain link fence shall be not more than  $1\frac{3}{4}$  inches (44 mm). Where the fence is provided with slats fastened at the top and bottom which reduce the openings, such openings shall be not more than  $1\frac{3}{4}$  inches (44 mm).

**305.2.8 Diagonal members.** Where the barrier is composed of diagonal members, the maximum opening formed by the diagonal members shall be not more than  $1\frac{3}{4}$  inches (44 mm). The angle of diagonal members shall be not greater than 45 degrees (0.79 rad) from vertical.

**305.2.9 Clear zone.** There shall be a clear zone of not less than 36 inches (914 mm) between the exterior of the barrier and any permanent structures or equipment such as pumps, filters and heaters that can be used to climb the barrier.

**305.2.10 Poolside barrier setbacks.** The pool or spa side of the required barrier shall be not less than 20 inches (508 mm) from the water's edge.

**305.3 Gates.** Access gates shall comply with the requirements of Sections 305.3.1 through 305.3.3 and shall be equipped to accommodate a locking device. Pedestrian access gates shall open outward away from the pool or spa, shall be self-closing and shall have a self-latching device.

**305.3.1 Utility or service gates.** Gates not intended for pedestrian use, such as utility or service gates, shall remain locked when not in use.

**305.3.2 Double or multiple gates.** Double gates or multiple gates shall have at least one leaf secured in place and the adjacent leaf shall be secured with a self-latching device. The gate and barrier shall not have openings larger than  $\frac{1}{2}$  inch (12.7 mm) within 18 inches (457 mm) of the latch release mechanism. The self-latching device shall comply with the requirements of Section 305.3.3.

**305.3.3 Latches.** Where the release mechanism of the self-latching device is located less than 54 inches (1372 mm) from grade, the release mechanism shall be located on the pool or spa side of the gate not less than 3 inches (76 mm) below the top of the gate, and the gate and barrier shall not have openings greater than  $\frac{1}{2}$  inch (12.7 mm) within 18 inches (457 mm) of the release mechanism.

**305.4 Structure wall as a barrier.** Where a wall of a dwelling or structure serves as part of the barrier and where doors or windows provide direct access to the pool or spa through that wall, one of the following shall be required:

1. Operable windows having a sill height of less than 48 inches (1219 mm) above the indoor finished floor and doors shall have an alarm that produces an audible warning when the window, door or their screens are opened. The alarm shall be *listed* and *labeled* as a water hazard entrance alarm in accordance with UL 2017. In dwellings or structures not required to be Accessible units, Type A units or Type B units, the operable parts of the alarm deactivation switches shall be located 54 inches (1372 mm) or more above the finished floor. In dwellings or structures required to be Accessible units, Type A units or Type B units, the operable parts of the alarm deactivation switches shall be located not greater than 54 inches (1372 mm) and not less than 48 inches (1219 mm) above the finished floor.
2. A *safety cover* that is *listed* and *labeled* in accordance with ASTM F 1346 is installed for the pools and spas.
3. An *approved* means of protection, such as self-closing doors with self-latching devices, is provided. Such means of protection shall provide a degree of protection that is not less than the protection afforded by Item 1 or 2.

**305.5 Onground residential pool structure as a barrier.** An onground *residential* pool wall structure or a barrier mounted on top of an onground *residential* pool wall structure shall serve as a barrier where all of the following conditions are present:

1. Where only the pool wall serves as the barrier, the bottom of the wall is on grade, the top of the wall is not less than 48 inches (1219 mm) above grade for the entire perimeter of the pool, the wall complies with the requirements of Section 305.2 and the pool manufacturer allows the wall to serve as a barrier.

